

Request Type :

Account Class :

Planner Group : MMG

Divisional Office : West-

Application Type : Device Installation Activity Code : 502

Category : Domestic TIKP

Consumer Details :	
App Order No : 1028893832	Consumer Name : ASH MANISH
Contract Account : 150202004	Father/Husband Name : MEHRA
Tarif Code : DOM3	Address : MS-90-FF-NORTH-PORTION
Email ID :	
Mobile No: []	Nearby Landmark : MS-BLOCK-HARI-NAR
	Landline No: [] [] [] [] [] [] [] []

TF Details :		
Existing Load(KW):	Pole/FP No(as per TF) : VKPPN627S1	Cable ReqdSize4x25 Lth/Loop IOOP
Additional Load(KW): 0.00	TF sticker No:	OldCableStatus:SizeLength.
		Laying of Cable: O/H <input type="checkbox"/> u/g <input type="checkbox"/>

Execution Details:	
Basic Start Date : 7-1-2022	Basic Finish Date :
Date of Meter Installation :	Time :

New Meter Details			Old/Existing Meter Details		
Meter No: SPH(10-60A)	EPH(20-100A)	LTCT	Meter No: 218723	SPH(10-60A)	TPH(20-100A)
CT Ratio: 0.0	PT Ratio: 0.0		CT Ratio:	PT Ratio:	
CT No:	PT No:		CT No:	PT No:	

Reading KWH:		KVAH:		Reading KWH: RAV		KVAH: RAV	
Meter Seal	Seal- 1: 00	Seal- 2:	Seal- 3:	Meter Seal	Seal- 1:	Seal- 2:	Seal- 3:
	Seal- 4: RAV576890				Seal- 4:		
Meter Terminal Seal	Seal- 1: RAV576891	Meter Terminal Seal	Seal- 1:				
Meter Box Seal	Seal- 1: RAV576892	Meter Box Seal	Seal- 1:				
	Seal- 2: RAV576893		Seal- 2:				

Gunny Bag No: Gunny Bag Seal No: RAA15531 Meter Test Date: 17-1-2022

Meter Accessories used at site: 123456789

Cable length installed... (m), Running length from...to...mtr, Size..., Installation: O/H U/G

Bus Bar Installed: Yes No B.B Size...Way 1PH/3PH Bus Bar No...B.B Plastic Seal No:.....

Meter Installed in Box: or Base Plate Energized from pole no:..

Material Removed From Site: Cable Bus Bar Box

Remarks : 98934 SIM []

This is to certify that the work of meter installation at the premises, has been done satisfactorily and no payment has been made to meter installation Team. There is no joint in service cable and Meter re/sealed properly.

Consumer/Representative's
 Sign: Name: Contact No:

** In case of any harassment, please call the following help line - BRPL-91-11-39999707

BSES Supervisor's Name: Contractor's Name & Stamp: RAVI

BSES Supervisor's ID: Contractor's Representative Name:

BSES Supervisor's Signature & Stamp: Contractor's Representative Signature:

Regd. Office: BSES Rajdhani Power Limited (A joint venture of Reliance Infrastructure Ltd & Govt. of NCT of Delhi) BSES Bhawan, Nehru Place, NEW DELHI-110019
 CTR NO.: 04010902001PLC111527, Telephone No: 011-3999 9707, Fax No: 011-3999 9890, Email: brpl.customercare@relianceceade.com, Website: www.bsesdelhi.com

NEW METER INSTALLATION QUALITY REPORT

CA NO. Customer Name Meter No.

Photograph Taken: Yes No DB/FP Locked: Yes No Earth(Both ends) OK Not OK

Meter Location: Outside Premise on wall Inside at entrance At BSES Pole Other(specify)--

Height of Meter: Correct Incorrect Any Joints in Service Cable before Meter: Yes No

Overhead Cable fixing: Consumer end: fastener/angle iron /pipe: Yes No Flower made at Yes No

Pole end: Yes No Meter Terminal: No

Additional Accessories Used: Gland Earth Nut Thimble Gland with M-Seal Saddle Clamp

Download Reading Through PDS Yes No

BSES

BSES Rajdhani Power Limited

S. No. BRLB

00098934

1028893832
E02

Date: 7-1-2022

LAB TESTING NOTICE OF REMOVED METER

TYPE : Meter Faulty/Display Faulty/Burnt/Load Enhancement/Reduction/Removal

To,

Div. J K P

Name: SHI-MANISH-MEHRA

Old Meter No. 60248223

Address: MS-90-FF-NORTH

Old Meter Reading KWH		RNV		
Old Meter Reading KVAH		RNV		
Gunny Bag No.	10230066			
Gunny Bag Seal No.	R	MANISH301		
Lab Testing Date	17	1	2022	

PORTION-MS-BLOCK HARTIV


CA No. 150202664

Vide MCR No. [] (KIT/LOOSE) & aforesaid details your old Energy Meter has been sealed in gunny bag in your presence and under your signatures. This meter will be sent to MMG laboratory located at **Sub Station No. 15, Sector No. 7, Pushp Vihar, New Delhi-110017**. The old aforesaid energy meter will be de-sealed in your presence during **10.30 AM to 01.00 PM or 02.00 PM to 03.00 PM** on date of lab testing. You can witness the investigation/testing process either in person or through your authorized representative (please give authority letter in this case duly attesting the signatures of authorized representative). In case at the appointed time you or your authorized representative fail to present yourself, the sealed meter shall be opened and tested in the MMG lab in your absence and results of the test report shall be binding on you. While appearing to witness the investigation/testing process, the user, consumer or his/her authorized representative must carry a valid photo identity along with an authority letter (if applicable).

For any further assistance, you may please contact **+011-4910 7968 (During working hours only)**

If the meter is suspected for unauthorized use of electricity or theft of electricity, the meter shall be tested by an accredited third party laboratory. Based on the test results, further action will be taken in accordance with the regulations / orders of Delhi Electricity Regulatory Commission and Electricity Act, 2003.

(BSES Engineer (MMG)) Signature: Name: Emp. No.:	(Consumer Name & Signature) The Content of the letter is explained to me and the meter is sealed in front of me. Name: Tel.:
---	---

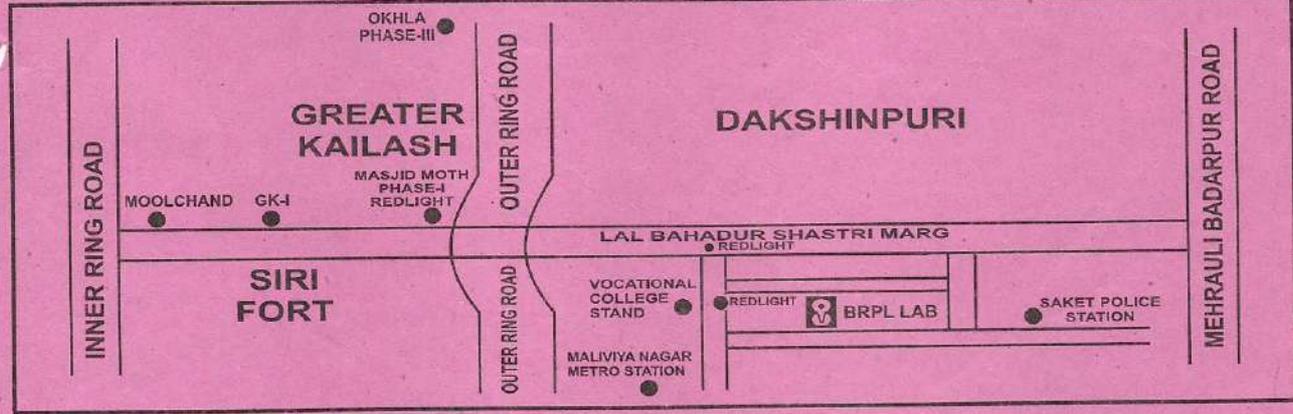

Registered Office : BSES Rajdhani Power Limited, BSES Bhawan, Nehru Place, New Delhi-110019
CIN No. : U40109DL2001PLC111527, Telephone No. : 011 4920 9707, Fax No. : 011 4920 9890
E-mail : brpl.customercare@relianceada.com, Website : www.bsesdelhi.com

PPP/23089159